Module position:

1.1 On the heat/cooling source2 On the heat/cooling source or on the wall3 In the station4 In the station or on the wall5 On the wall6 In the controller

The system schematic shown is a non−binding schematic diagram.The circuit diagram/connection diagram contains details on the electrical wiring. Observe national and regional regulations, techical rules and guidelines.

No.	6721836178
State	17.03.2021

Bosch

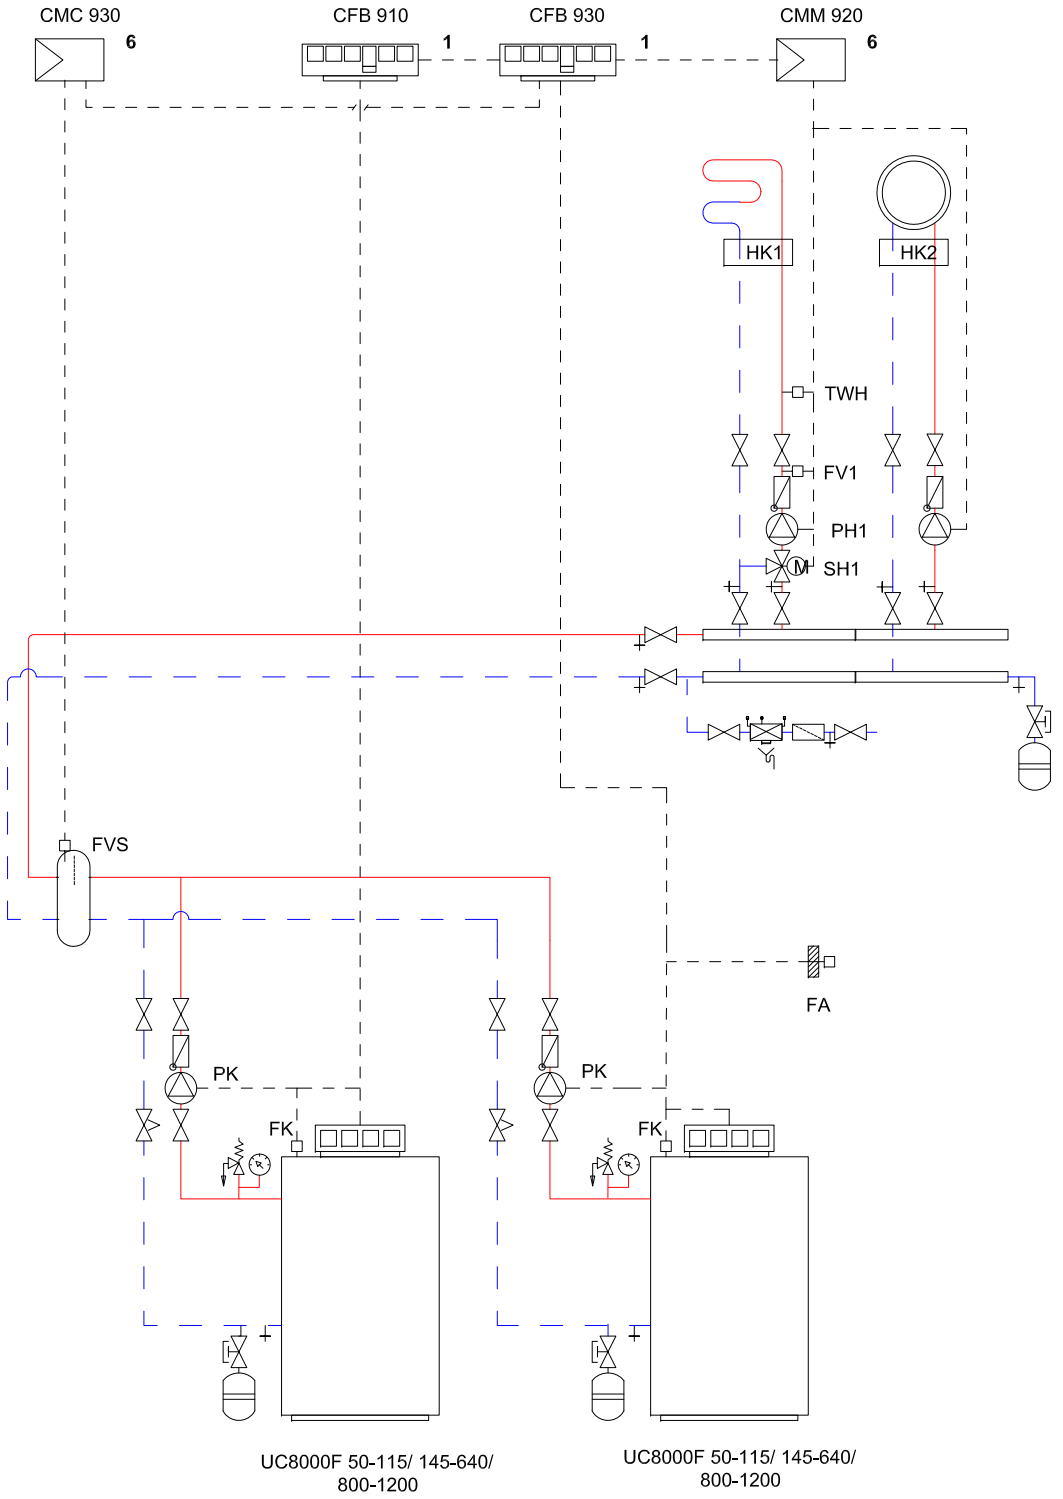

BOSCH

Explanation of symbols

Symbol	Name	Symbol	Name	Symbol	Name
Pipework/cables					
	Flow - heating/solar		Brine return		DHW circulation
	Return - heating/solar		Potable water		Electrical wiring
	Brine flow		DHW		Electrical wiring with break
Mixing valves/valves/temperature sensors/pumps					
	Valve		Pressure differential controller		Pump
	Inspection bypass		Pressure relief valve		Non-return valve
	Flow regulating valve		Safety assembly		Temperature sensor/switch
	Pressure relief valve		3-way mixing valve (mixing/distribution)		Safety temperature limiter
	Filter shut-off valve		DHW mixer, thermostatic		Flue gas temperature sensor/switch
	Cap valve		3-way mixing valve (changeover)		Flue gas temperature limiter
	Valve, mechanically controlled		3-way mixing valve (change over, de-energised when closed to II)		Outside temperature sensor
	Valve, thermally controlled		3-way mixing valve (change over, de-energised when closed to A)		Wireless outside temperature sensor
	Shut-off valve, magnetically controlled		4-way mixing valve		...wireless...
Miscellaneous					
	Thermometers		Drain outlet with siphon		Low loss header with sensor
	Manometer		System separation according to EN1717		Heat exchanger
	Drain & fill valve		Expansion vessel with cap valve		Flow rate measuring device
	Water filter		Magnetite separator		Tundish
	Heat meter		Air separator		Heating circuit
	DHW outlet		Automatic air vent		Underfloor heating circuit
	Relay		Expansion joint		Low loss header
	Immersion heater				

Descriptions

KR Flow-check valve
PK Boiler circuit pump
RK Return
VK Flow
VSL Safety flow
SR Actuator, return temperature raising facility
SV Pressure relief valve
SK Boiler circuit actuator
SH Heating circuit actuator
VHK Heating circuit flowrate
VPK Boiler circuit pump flow rate
TWH Flow temperature limiter
DV Throttle valve
FA Outside temperature sensor
FK Boiler temperature sensor
FV Flow temperature sensor
FB DHW temperature sensor
FZ Auxiliary temperature sensor
FVS Strategy sensor
FR Return temperature sensor
PK Boiler circuit pump
PH Heating circuit actuator
PS Cylinder primary pump
PZ DHW circulation pump

Low loss header

A low loss header (hydraulic balancing) is used to hydraulically separate the boiler circuit and the heating circuits.

Installing a low loss header brings many benefits:

- Sizing boiler circuit pump and actuators is easy. Interaction between the heating water flow inside the boiler and in the heat consumer circuits is prevented. Boiler and heat consumers are only supplied with the assigned water flow.
- May be used in single and multi-boiler systems, subject to the heating circuit control system.
- Actuators on both sides of the low loss header provide optimum operation if they are sized correctly. The hydraulic balancing line can also be used as a sludge trap, subject to being sized correctly.
- Where there is a large pressure drop on the water side and large distances between boiler and heating circuits, a split into primary and secondary side is possible.

Sizing the low loss header

Correct sizing is crucial to the function of the low loss header. To ensure good separation with the simultaneous function as a dirt separator, size the line in such a way that there is virtually no pressure drop between the flow and return. At the nominal amount of water, a flow velocity of 0.1 m/s to 0.2 m/s can be expected. This also enables the simultaneous use as a sludge trap. To be able to capture the heating circuit flow temperature, provide a sensor well of 200 mm to 300 mm length in the upper area of the hydraulic balancing line on the heating circuit side.

$$D = \sqrt{\frac{\dot{V}_{Kges}}{v} \times \frac{1}{2827}}$$

Calculating the size of the low loss header

D	Diameter of the hydraulic balancing line in m
v	Flow velocity in m/s
$\dot{V}_{Kges}$	Total boiler circuit flow rate in m^3/h

Example

Given:

- Total flow rate $\dot{V}_{Kges}$ = 223.6 m^3/h
- Flow velocity (assumption) v = 0.2 m/s

Result:

- Diameter of the hydraulic balancing line D ~ 0.63 m

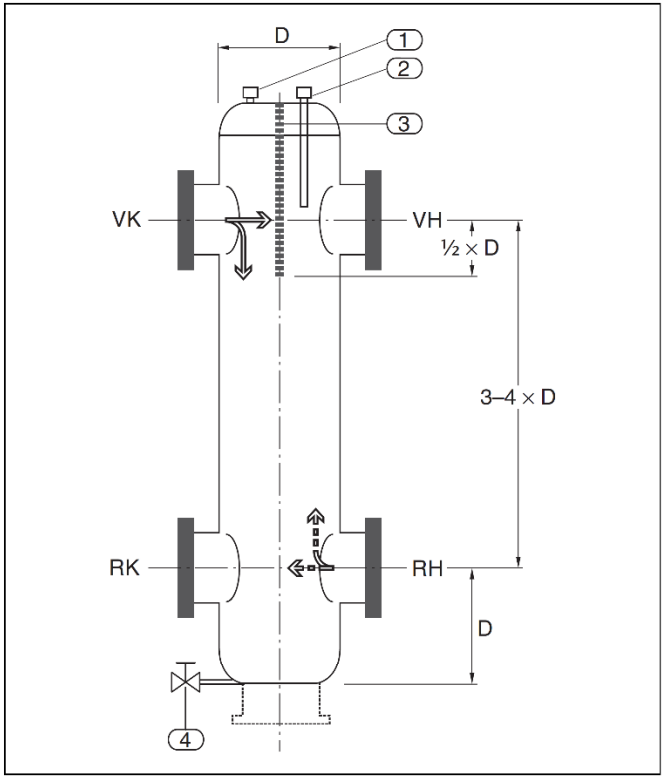

Main diagram of a low loss header

RH	Heating system return
RK	Return
VH	Heating system flow
VK	Flow
[1]	Female connection for an air vent valve
[2]	Female connection for a sensor well ½ "
[3]	Perforated partition
[4]	Quick-acting valve